

# *Recall*

---

## **Principles of Feedback**

*Topics to be covered include:*

- y An industrial motivational example;
- y A statement of the fundamental nature of the control problem;
- y Evolution from open loop inversion to closed loop feedback solutions.

15/03/2009

1/17

---

We will see that feedback is a key tool that can be used to modify the behaviour of a system.

This behaviour altering effect of feedback is a key mechanism that control engineers exploit deliberately to achieve the objective of acting on a system to ensure that the desired performance specifications are achieved.

# A motivating industrial example

---


We first present a simplified, yet essentially authentic, example of an industrial control problem. The example, taken from the steel industry, is of a particular nature, however the principal elements of specifying a desired behaviour, modelling and the necessity for trade-off decisions are generic.

15/03/2009

3/17

## *Photograph of Bloom Caster*


---

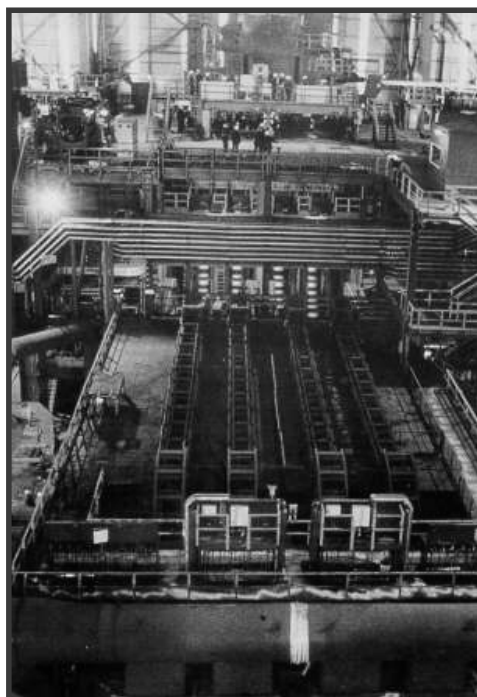

15/03/2009

4/17


## *Process schematic of an Industrial Bloom Caster*

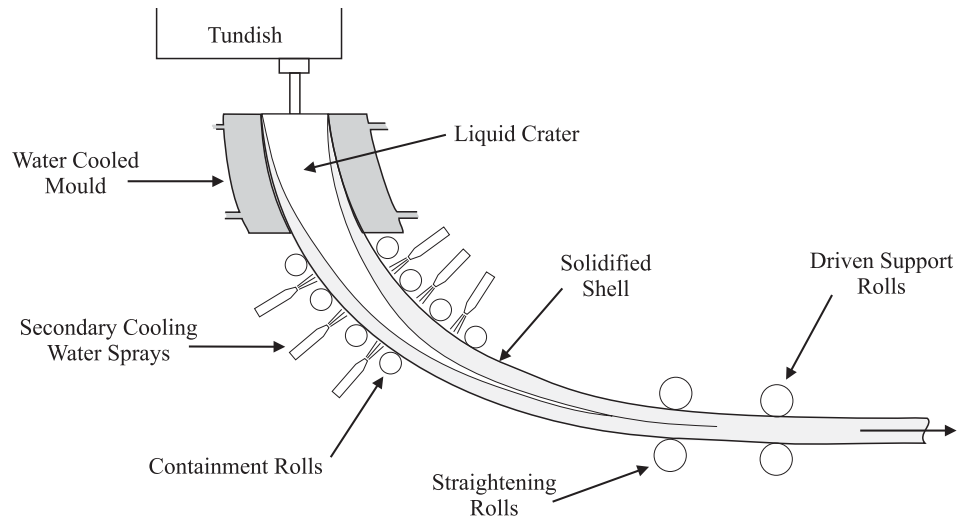

15/03/2009

5/17

## *Continuous caster. Typical bloom (left) and simplified diagram (right)*

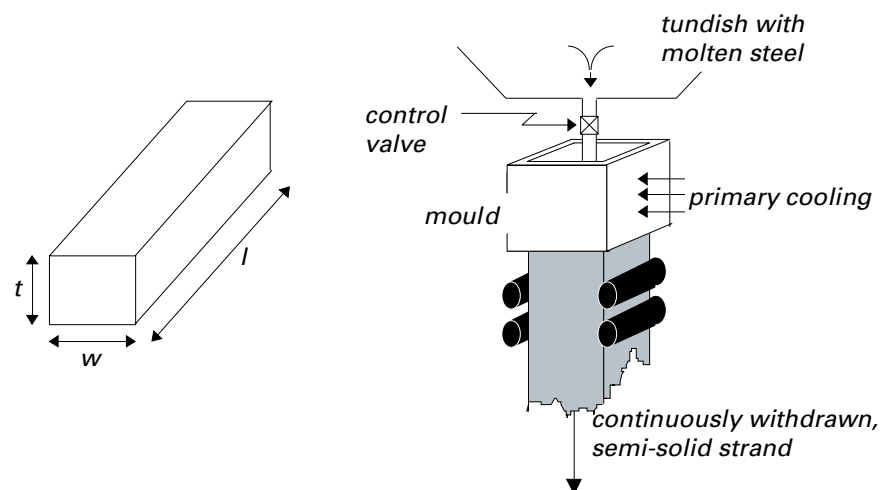

15/03/2009

6/17

# Performance specifications

---

The key performance goals for this problem are:

- γ *Safety*: Clearly, the mould level must never be in danger of overflowing or emptying as either case would result in molten metal spilling with disastrous consequences.
- γ *Profitability*: Aspects which contribute to this requirement include:
  - × Product quality
  - × Maintenance
  - × Throughput

15/03/2009

7/17

# Modelling

---

To make progress on the control system design problem, it is first necessary to gain an understanding of how the process operates. This understanding is typically expressed in the form of a mathematical model.

$h^*$  : commanded level of steel in mould

$h(t)$  : actual level of steel in mould

$v(t)$  : valve position


$\sigma(t)$  : casting speed

$q_{in}(t)$  : inflow of matter into the mould

15/03/2009  $q_{out}(t)$  : outflow of matter from the mould

8/17

# Model as simple tank

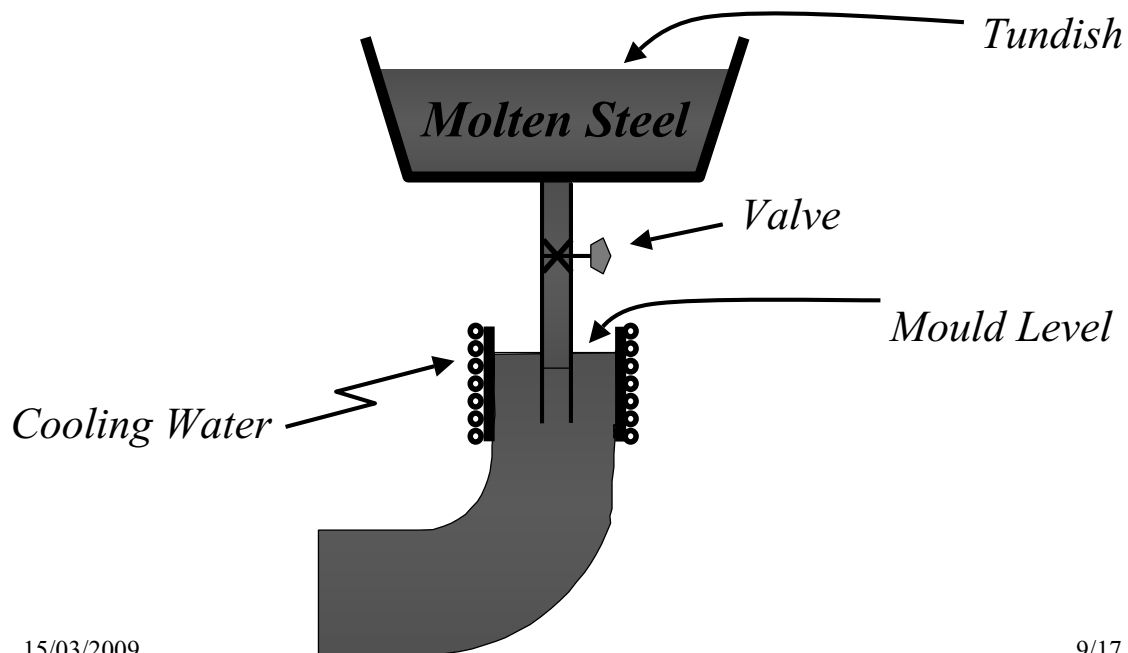


15/03/2009

9/17

*Block diagram of the simplified mould level dynamics, sensors and actuators*

These variables are related as shown below:

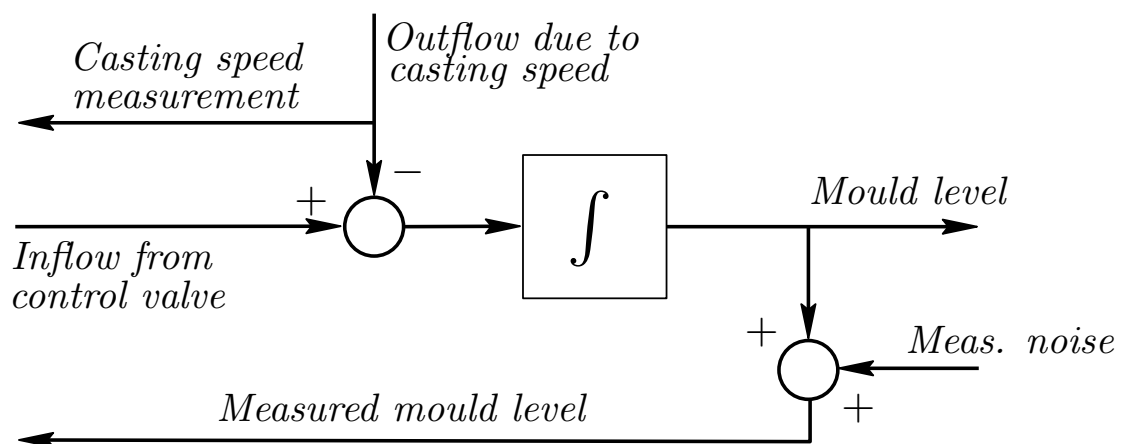

15/03/2009

10/17

# Definition of the control problem

---

Abstracting from the above particular problem, we can introduce:

## ***Definition 2.1:***

*The central problem in control is to find a technically feasible way to act on a given process so that the process behaves, as closely as possible, to some desired behaviour. Furthermore, this approximate behaviour should be achieved in the face of uncertainty of the process and in the presence of uncontrollable external disturbances acting on the process.*

11/17



## From open to closed loop architectures

---

Unfortunately, the open loop methodology will not lead to a satisfactory solution to the control problem unless:

- y the model on which the design of the controller has been based is a very good representation of the plant,
- y the model and its inverse are stable, and
- y disturbances and initial conditions are negligible.

We are thus motivated to find an alternative solution to the problem which retains the key features but which does not suffer from the above drawbacks.

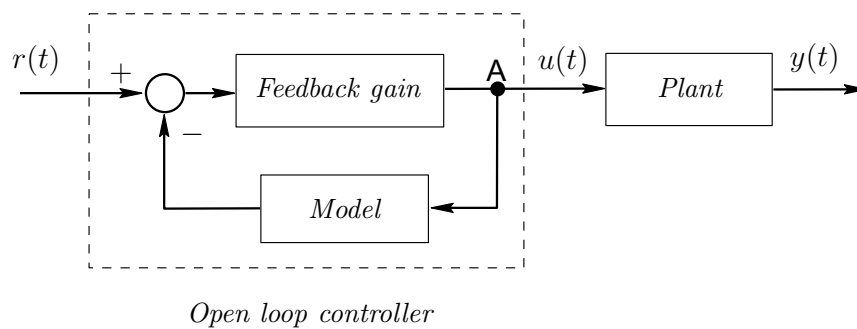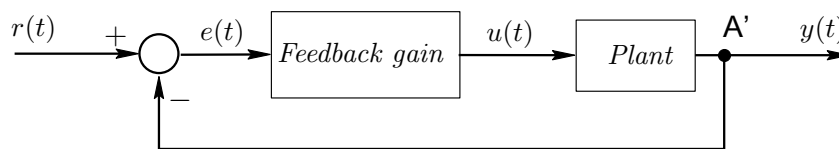Figure 2.9: *Open loop controller*Figure 2.10: *Closed loop control*

15/03/2009

13/17

## Open loop solution

- y The first thing to note is that, provided **the model represents the plant exactly**, and that all signals are bounded (i.e. the loop is stable), then both schemes are equivalent, regarding the relation between  $r(t)$  and  $y(t)$ . The key differences are due to **disturbances and different initial conditions**.
- y In the **open loop control scheme** the controller incorporates feedback internally, i.e. a signal at point A is fed back.

# Closed loop scheme

---

y In the **closed loop scheme**, the feedback signal depends on what is actually happening in the plant since the true plant output is used.

We will see later that this modified architecture has many advantages including:


- × **insensitivity to modelling errors;**
- × **insensitivity to disturbances in the plant (*that are not reflected in the model*).**

15/03/2009

15/17

## *Closed loop control with sensors*

---

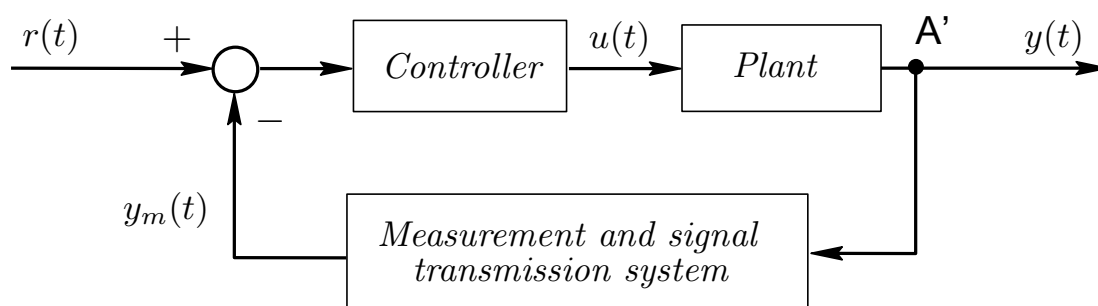

15/03/2009

16/17

## *Typical feedback loop*

---

In summary, a typical feedback loop (including sensor issues) is shown below.

